




ELECTRICAL SITE PLAN  
SCALE: 1" = 40'-0"

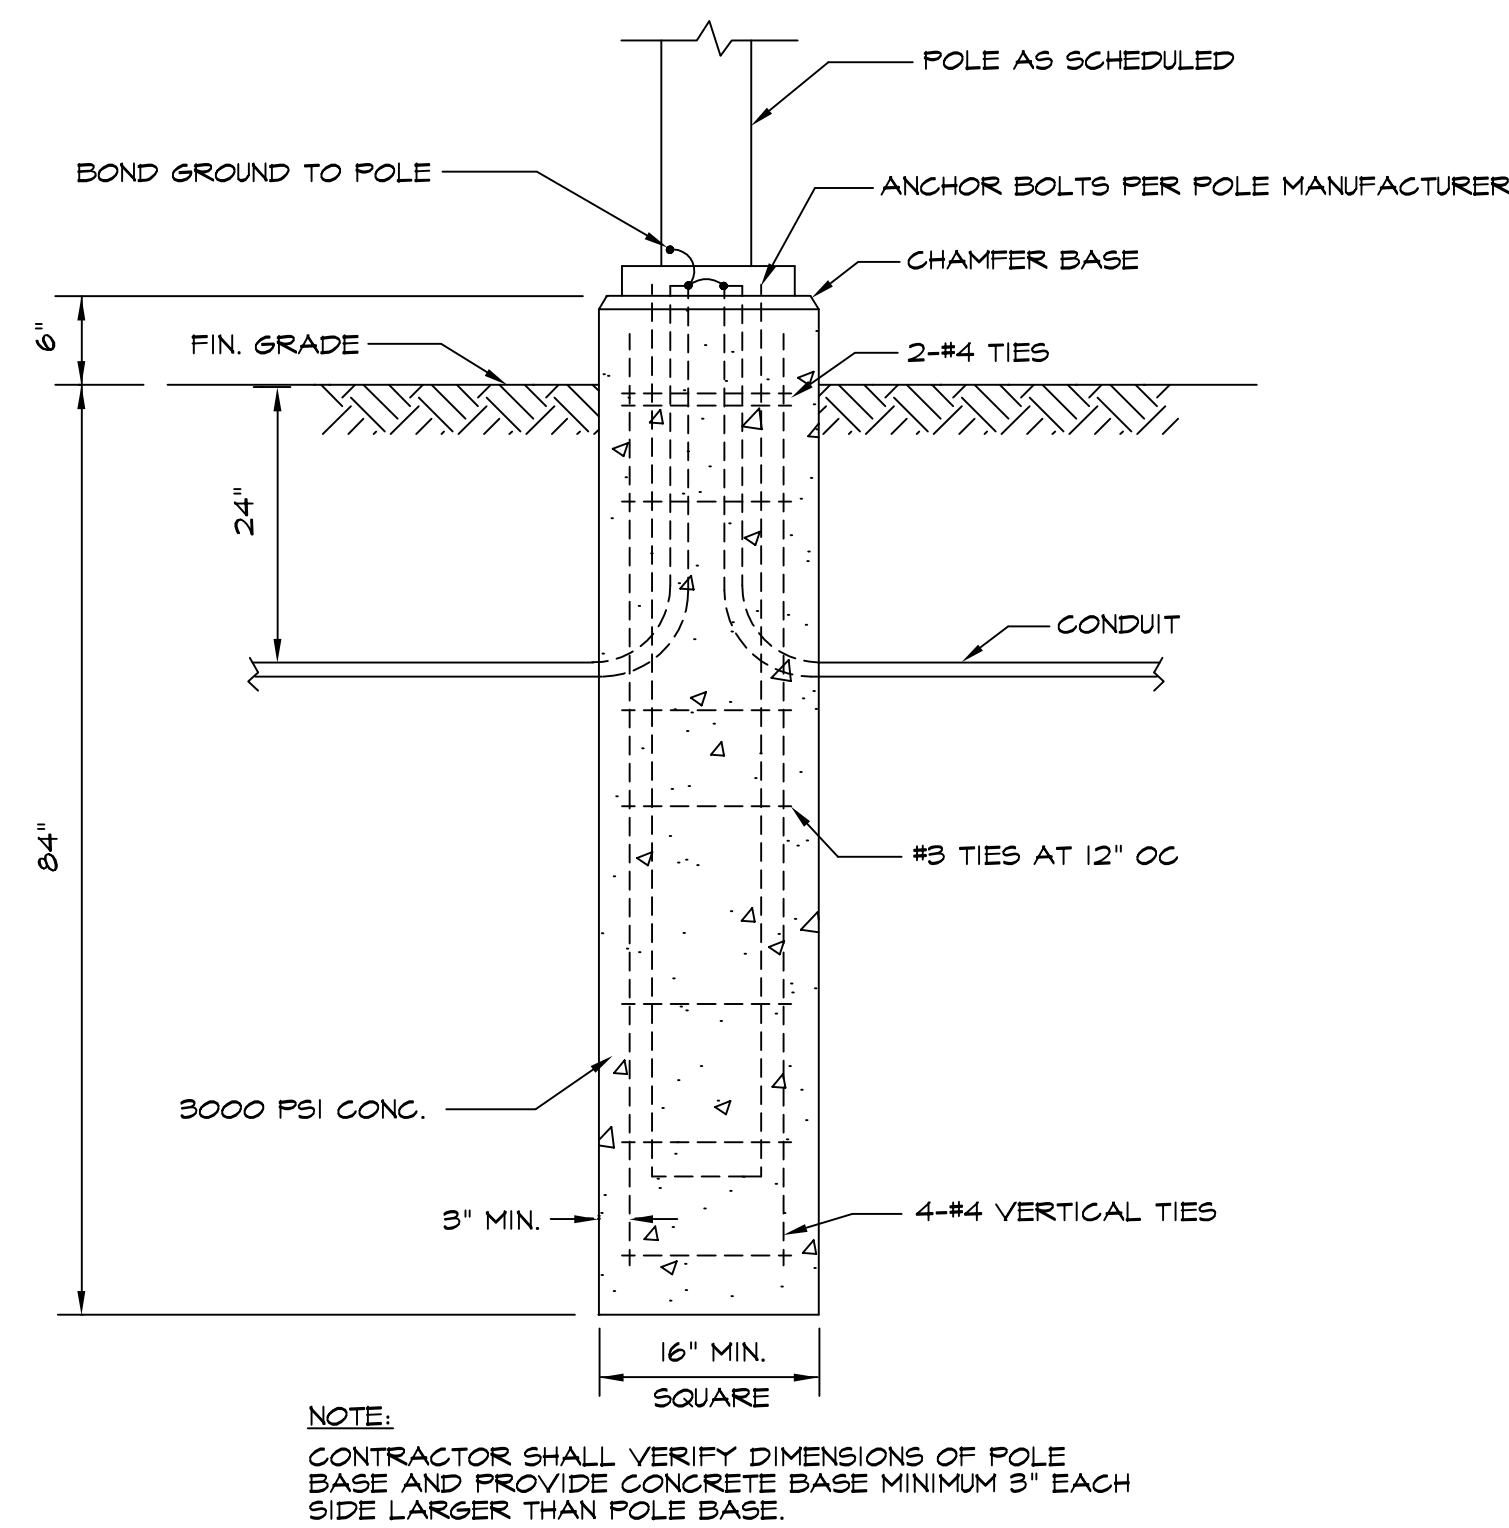

LIGHT STANDARD DETAIL  
SCALE: NONE

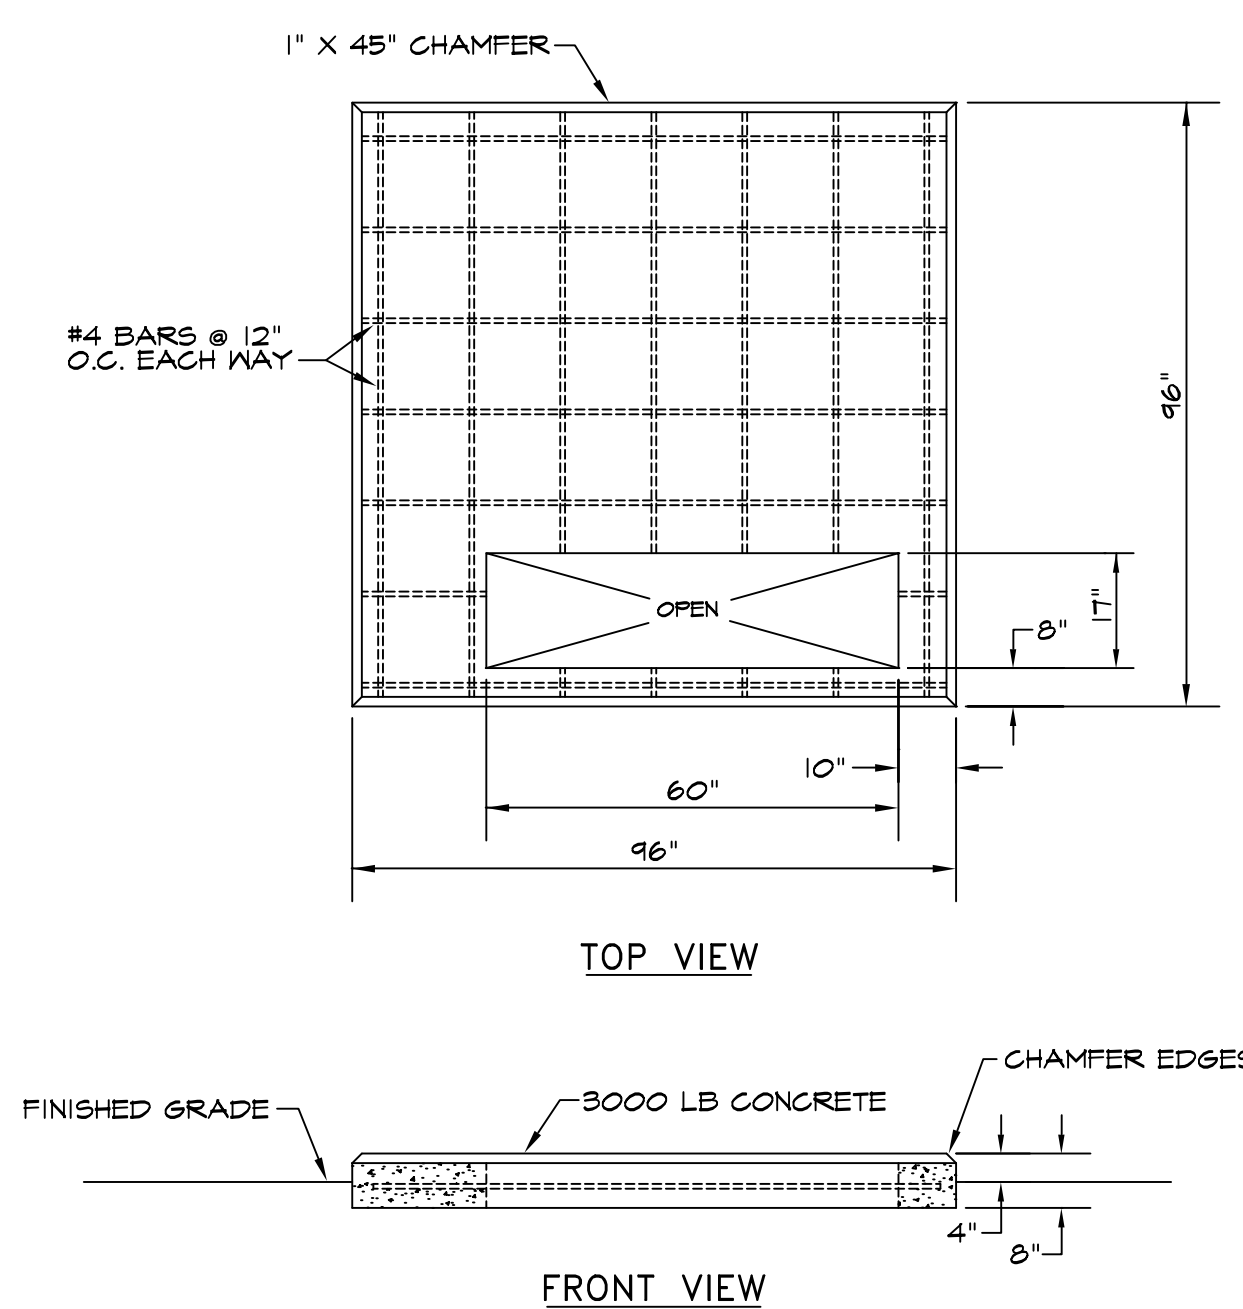

TRANSFORMER PAD DETAIL  
SCALE: NONE

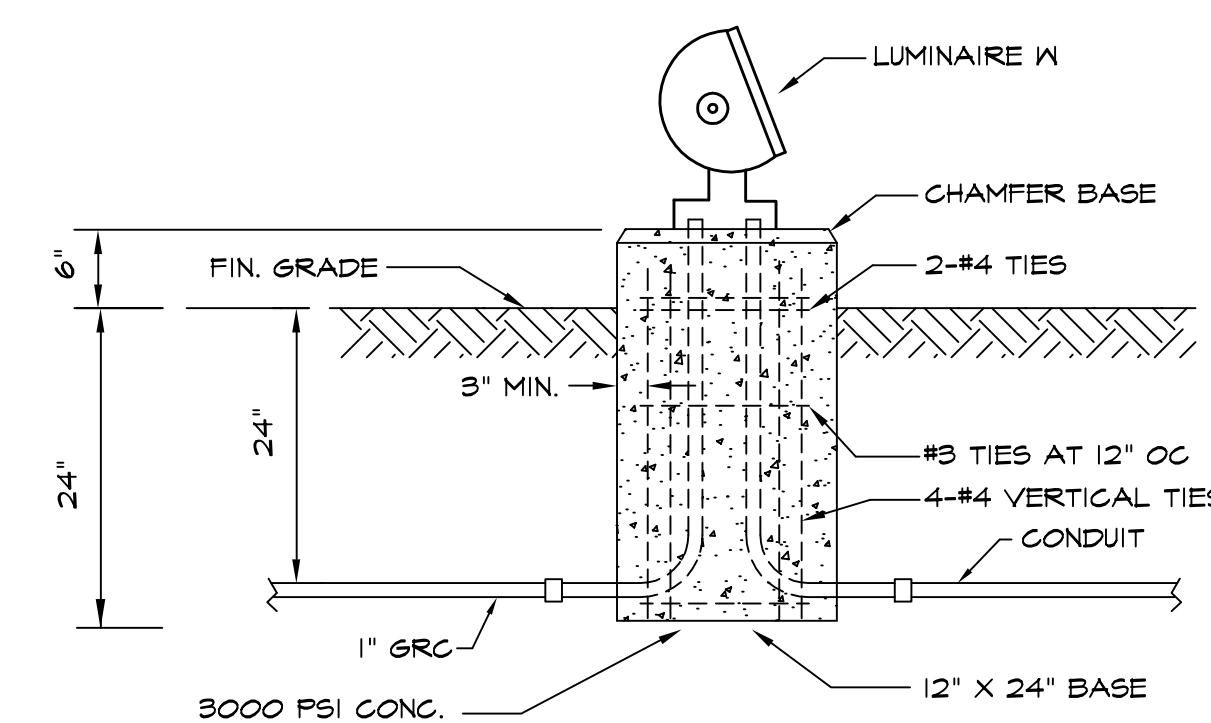

LUMINAIRES W DETAIL  
SCALE: NONE

ELECTRICAL LEGEND			
SYMBOL	DESCRIPTION	MOUNTING	REMARKS
	FLUORESCENT LUMINAIRE	CEILING	SEE LUMINAIRE SCHEDULE
	FLUORESCENT LUMINAIRE	WALL	SEE LUMINAIRE SCHEDULE
	FLUORESCENT/INCANDESCENT/HID LUMINAIRE	CEILING	SEE LUMINAIRE SCHEDULE
	HID/INCANDESCENT LUMINAIRE	WALL	SEE LUMINAIRE SCHEDULE
	SCONCE	WALL	SEE LUMINAIRE SCHEDULE
	HID LUMINAIRE	POLE	SEE LUMINAIRE SCHEDULE
\$	SINGLE POLE SWITCH, 20 AMP, 120/277V	48" AFF	WITH STAINLESS STEEL COVERPLATE
\$3	THREE-WAY SWITCH, 20 AMP, 120/277V	48" AFF	WITH STAINLESS STEEL COVERPLATE
\$5	DIMMER SWITCH, 1500W, 120V	48" AFF	WITH STANDARD MFR'S COVERPLATE
\$PS	PROJECTION SCREEN CONTROL	48" AFF	FURN. BY OTHERS INSTALLED BY CONT.
\$C	THREE POSITION MAINT. CONTACT SWITCH	48" AFF	WITH STAINLESS STEEL COVERPLATE
☐	PHOTO ELECTRIC CONTROL SWITCH	WALL	FACE NORTH
⌚	TIME CLOCK	WALL	SEE SPECIFICATIONS
⌚	DUPLEX RECEPTACLE, 20 AMP, 2P, 3W, 125V	18" AFF/NTD	WITH STAINLESS STEEL COVERPLATE
⌚H	DUPLEX RECEPTACLE, 20 AMP, 2P, 3W, 125V	HORIZ/NTD	WITH STAINLESS STEEL COVERPLATE
⌚C	DUPLEX RECEPTACLE, 20 AMP, 2P, 3W, 125V	ABOVE CLG	WITH GALVANIZED STEEL COVERPLATE
⌚Q	QUADRAPLEX RECEPTACLE, 20 AMP, 2P, 3W, 125V	18" AFF/NTD	WITH STAINLESS STEEL COVERPLATE
⌚F	DUPLEX RECEPTACLE, 20 AMP, 2P, 3W, 125V	FLUSH FLOOR	WITH BRASS COVERPLATE
⌚QF	QUADRAPLEX RECEPTACLE, 20 AMP, 2P, 3W, 125V	FLUSH FLOOR	WITH BRASS COVERPLATE
⌚S	SINGLE RECEPTACLE, 30 AMP, 3P, 4W, 250V	18" AFF/NTD	SEE SPECIFICATIONS
⌚GFI	GFI DUPLEX RECEPTACLE, 20 AMP, 2P, 3W, 125V	42" AFF	WITH STAINLESS STEEL COVERPLATE
⌚GFI	GFI DUPLEX RECEPTACLE, 20 AMP, 2P, 3W, 125V	18" AFF	WITH WEATHERPROOF COVERPLATE
⌚S	SINGLE RECEPTACLE, 30 AMP, 3P, 4W, 120V	18" AFF/NTD	WITH STAINLESS STEEL COVERPLATE
⌚S	SINGLE RECEPTACLE, 20 AMP, 3 P, 3W, 120/208V	18" AFF/NTD	WITH STAINLESS STEEL COVERPLATE
⌚	SPECIAL ELECTRICAL CONNECTION	AS REQUIRED	
⌚DL	DOOR LOCK POWER SUPPLY CONNECTION	ABV. CLG	COORDINATE WITH SUPPLIER
⌚WH	WATER HEATER CONNECTION	AS REQUIRED	
⌚AC	AIR CURTAIN CONNECTION	AS REQUIRED	
⌚PS	PROJECTION SCREEN CONNECTION	AS REQUIRED	
⌚ELEV	ELEVATOR EQUIPMENT CONNECTION	AS REQUIRED	
⌚DW	DISH WASHER CONNECTION	AS REQUIRED	
⌚	JUNCTION BOX	AS REQUIRED	SEE SPECIFICATIONS
⌚	REMOTE DIMMER CONTROL	WALL	SEE SPECIFICATIONS
⌚	MASTER DIMMER CONTROL	DESKTOP	SEE SPECIFICATIONS
⌚	DIMMER RACK	WALL	SEE SPECIFICATIONS
⌚	LIGHTING CONTACTOR	WALL	SEE SPECIFICATIONS
⌚	VARIABLE FREQUENCY DRIVE	WALL	FURN UNDER DIVISION 15
⌚	SAFETY SWITCH	WALL	SEE SPECIFICATIONS
⌚	COMBINATION STARTER/FUSED SAFETY SWITCH	WALL	SEE SPECIFICATIONS
⌚	LIGHT/POWER PANELBOARD	WALL	SEE PANELBOARD SCHEDULE
⌚	DISTRIBUTION PANELBOARD	WALL	SEE PANELBOARD SCHEDULE
⌚	ENCLOSED CIRCUIT BREAKER W/SHUNT TRIP	WALL	SEE SPECIFICATIONS
⌚	DRY TYPE TRANSFORMER	FLOOR	SEE SPECIFICATIONS
⌚	MOTOR	—	HORSEPOWER NOTED
⌚	TRANSIENT VOLTAGE SURGE SUPPRESSOR-TVSS	WALL	SEE SPECIFICATIONS
⌚	TELEPHONE/COMMUNICATIONS TERMINAL BOARD	WALL	SEE SPECIFICATIONS
⌚	TELEPHONE/DATA OUTLET	18" AFF/NTD	SEE SPECIFICATIONS
⌚	TELEPHONE/DATA OUTLET	FLUSH FLOOR	SEE SPECIFICATIONS
⌚	DATA OUTLET	ABOVE CEILING	SEE SPECIFICATIONS
⌚	TELEVISION OUTLET	18" AFF/NTD	SEE SPECIFICATIONS
⌚	DATA SYSTEM TERMINAL BOX	18"/NOTED	SEE SPECIFICATIONS
⌚	CEILING SPEAKER	FLUSH CEILING	SEE SPECIFICATIONS
⌚	MICROPHONE WALL OUTLET	18"/NOTED	SEE SPECIFICATIONS
⌚	MICROPHONE FLOOR OUTLET	FLUSH FLOOR	SEE SPECIFICATIONS
⌚	SOUND SYSTEM TERMINAL BOX	18"/NOTED	SEE SPECIFICATIONS
⌚	ASSISTED LISTENING OUTLET	FLUSH FLOOR	SEE SPECIFICATIONS
⌚	MANUAL PULL STATION	48" AFF	SEE SPECIFICATIONS
⌚	SMOKE DETECTOR	CEILING	SEE SPECIFICATIONS
⌚	THERMAL DETECTOR	CEILING	SEE SPECIFICATIONS
⌚	SMOKE DETECTOR	DUCT	SEE SPECIFICATIONS
⌚	FIRE ALARM SPEAKER/STROBE SIGNAL	90" AFF	SEE SPECIFICATIONS
⌚	FIRE ALARM STROBE SIGNAL	90" AFF	SEE SPECIFICATIONS
⌚	FIRE ALARM CONTROL CABINET	WALL	SEE SPECIFICATIONS
⌚	FIRE ALARM ANNUNCIATOR PANEL	WALL	SEE SPECIFICATIONS
⌚	FIRE ALARM SPECIAL CONNECTION	AS REQUIRED	SEE SPECIFICATIONS
⌚	SOLENOID VALVE CONNECTION	AS REQUIRED	SEE SPECIFICATIONS
⌚	GATE VALVE CONNECTION	AS REQUIRED	SEE SPECIFICATIONS
⌚	FM 200 CONTROL PANEL (FURN UNDER DIVISION 15)	AS REQUIRED	CONNECT TO SYSTEM
⌚	FIRE ALARM DOOR RELEASE CONNECTION	AS REQUIRED	SEE SPECIFICATIONS
⌚	CABLE TRAY	ABOVE CEILING	SEE SPECIFICATIONS
⌚	FLEXIBLE CONDUIT	—	SEE SPECIFICATIONS
⌚	CONDUIT CONCEALED	—	SEE SPECIFICATIONS
⌚	CONDUIT EXPOSED	—	SEE SPECIFICATIONS
⌚	CONDUIT BELOW FLOOR/GRADE	—	SEE SPECIFICATIONS
⌚	CIRCUIT CONDUCTORS IN CONDUIT	—	SEE SPECIFICATIONS
⌚	GROUND CONDUCTOR IN CONDUIT	—	SEE SPECIFICATIONS
⌚	GROUNDING ELECTRODE	—	SEE SPECIFICATIONS
⌚	CONDUIT UP	—	SEE SPECIFICATIONS
⌚	CONDUIT DOWN	—	SEE SPECIFICATIONS
⌚	NEW UNDERGROUND PRIMARY CONDUIT	—	SEE SPECIFICATIONS
⌚	SPEAKER CONDUIT/WIRING	—	SEE SPECIFICATIONS
⌚	MICROPHONE CONDUIT/FULL CORD	—	SEE SPECIFICATIONS